



PLAN

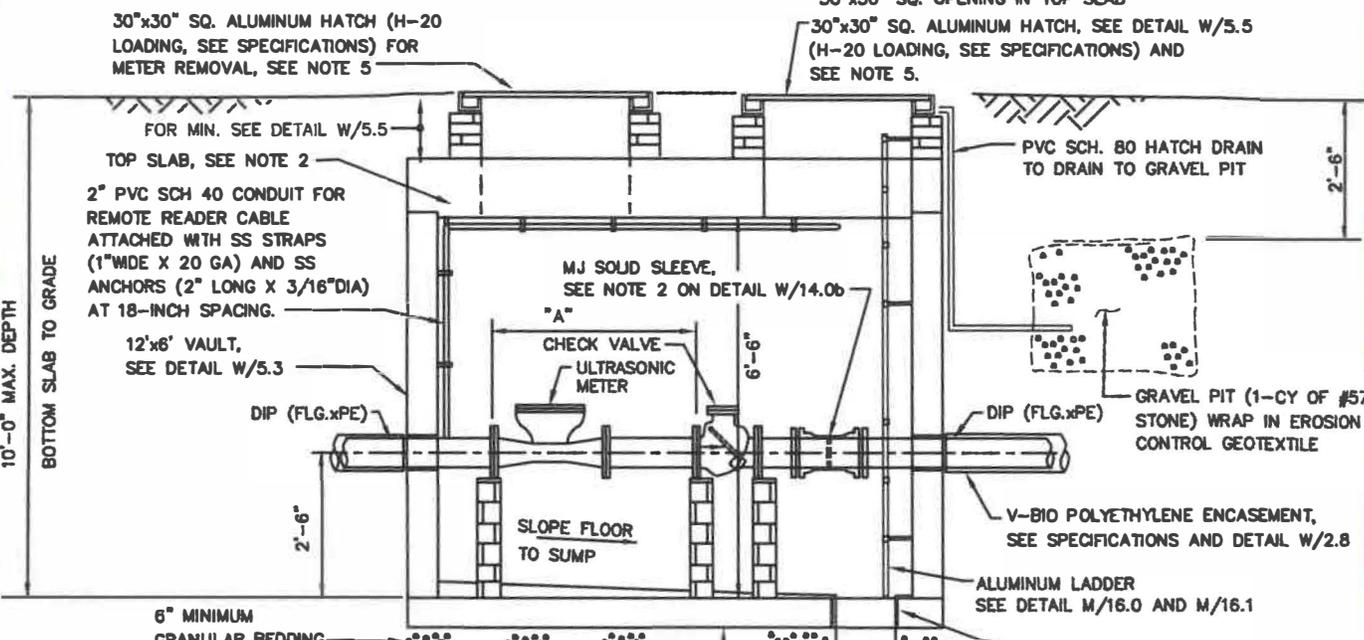

ELEVATION

NOTES:

1. FOR PIPE AND METER SIZES, PIPING LAYOUT AND NOTES, SEE DETAIL W/14.0b
2. FOR TOP SLAB DETAILS, SEE DETAIL W/5.26.
3. FOR DIMENSION "A", SEE DETAIL W/14.0b.
4. FOR LOCATION OF BY-PASS PIPING, SEE DETAIL W/14.0b.
5. IF VAULT LOCATION IS LOCATED IN TRAFFIC AREA, USE 30" DIA. FRAME AND COVER AND REMOTE READING DEVICE, FOR LOCATION SEE W/14.0b.
6. FOR REMOTE READING DEVICE, SEE DETAIL W/5.0e.
7. BENDS IN REMOTE READER CONDUIT NOT TO EXCEED 45° PER FITTING UNLESS USING A 90° SWEEP.
8. CONTRACTOR SHALL INSTALL REMOTE READER HOUSING, ALL CONDUIT AND WIRING. METER SERVICES SHALL INSTALL THE REMOTE READING DEVICE AND PERFORM FINAL WIRING TO THE METER.

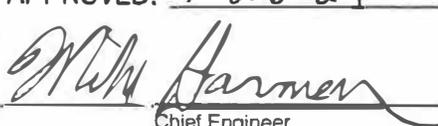WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>7-26-21</u>  Chief Engineer	STANDARD DETAIL 10-INCH ULTRASONIC METER WITH CHECK VALVE VAULT	W <hr/> 14.1c
--	---	---	------------------