


PVC PRESSURE SEWER HOUSE CONNECTION

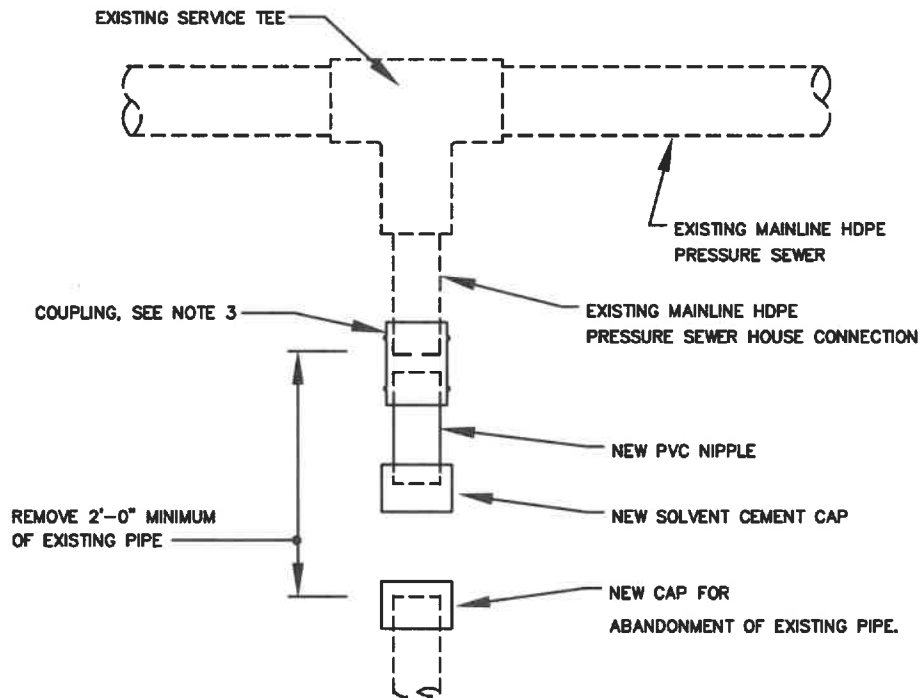

HDPE PRESSURE SEWER HOUSE CONNECTION

NOTES:

1. FOR PIPE SIZES, SEE DRAWINGS.
2. IF EXISTING SERVICE TEE HAS GASKET TYPE JOINTS, PROVIDE BLOCKING FOR CAP, SEE DETAIL 1.41.
3. COUPLING FOR EXISTING HDPE, SEAL AND RESTRAINT TYPE MECHANICAL COUPLING, SEE SPECIFICATIONS.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 7-26-21
Mike Hammer
Chief Engineer

STANDARD DETAIL
ABANDONMENT OF EXISTING
PRESSURE SEWER
HOUSE CONNECTION

PS
6.0