


ALL WIRES TO BE ROUTED IN PVC CONDUIT UNTIL TEST STATION ASSEMBLY REACHED. WIRES TERMINATED IN TEST STATION PER WSSC STANDARD DETAIL C/4.0 FOR FLUSH MOUNT TEST STATION OR C/4.2 POST MOUNT TEST STATION.

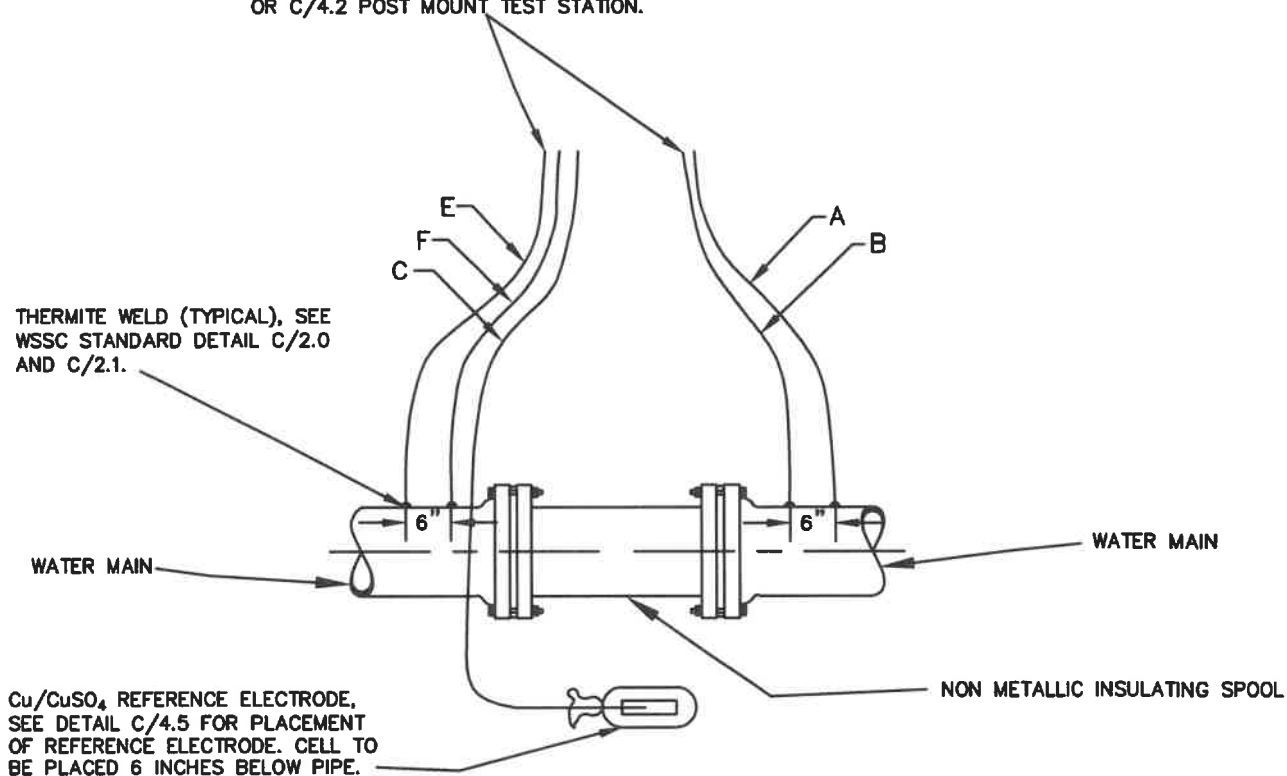

WIRING SCHEDULE

DESCRIPTION	WIRE	TEST STATION TERMINAL	AWG WIRE SIZE	TYPE OF INSULATION	COLOR OF INSULATION
MAIN ON LEFT SIDE OF SPOOL	A B	1 3	#12 #6	THWN THWN	BLACK BLACK
PERMANENT REFERENCE ELECTRODE	C	6	PER MANUFACTURER	PER MANUFACTURER	PER MANUFACTURER
MAIN ON RIGHT SIDE OF SPOOL	E F	2 5	#12 #6	THWN THWN	WHITE WHITE

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 7-26-21
Mike Harmon
Chief Engineer

STANDARD DETAIL
INSULATING SPOOL

C
3.2b