


POLYCARBONATE TERMINAL
BLOCK/BOARD SUPPLIED WITH TEST
STATION, SEE SPECIFICATIONS.

0.01 OHM SHUNT (WHEN
REQUIRED), PER
SPECIFICATIONS.

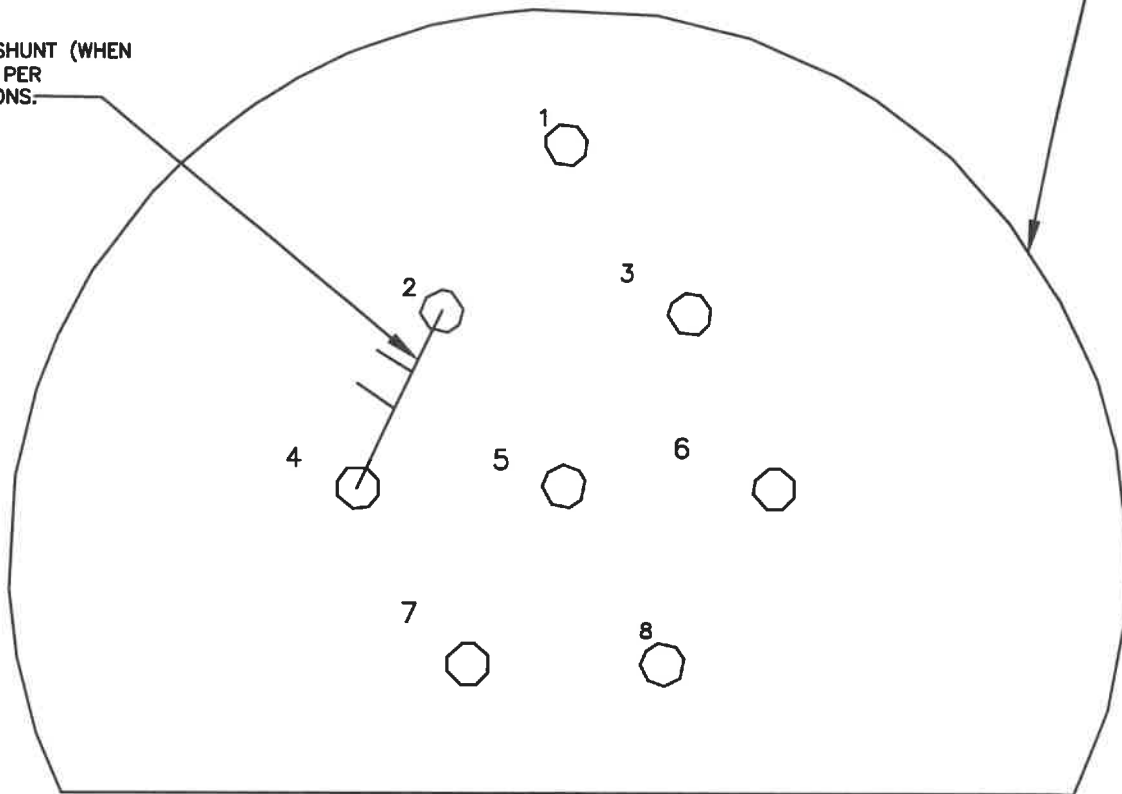

- TERMINAL #1 - NEW WATER MAIN
- TERMINAL #2 - EXISTING PIPE
- TERMINAL #3 - NEW WATER MAIN
- TERMINAL #4 - PREPACKAGED MAGNESIUM ANODE LEAD WIRES
- TERMINAL #5 - EXISTING PIPE
- TERMINAL #6 - PERMANENT REFERENCE ELECTRODE
- TERMINAL #7 - EMPTY
- TERMINAL #8 - EMPTY

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 7-26-21

M. J. Hamer
Chief Engineer

STANDARD DETAIL

FLUSH MOUNTED TEST
STATION TERMINAL BLOCK

C
4.0a