


POLYCARBONATE TERMINAL
BLOCK/BOARD SUPPLIED WITH TEST
STATION, SEE SPECIFICATIONS.

METALLIC BOND BAR

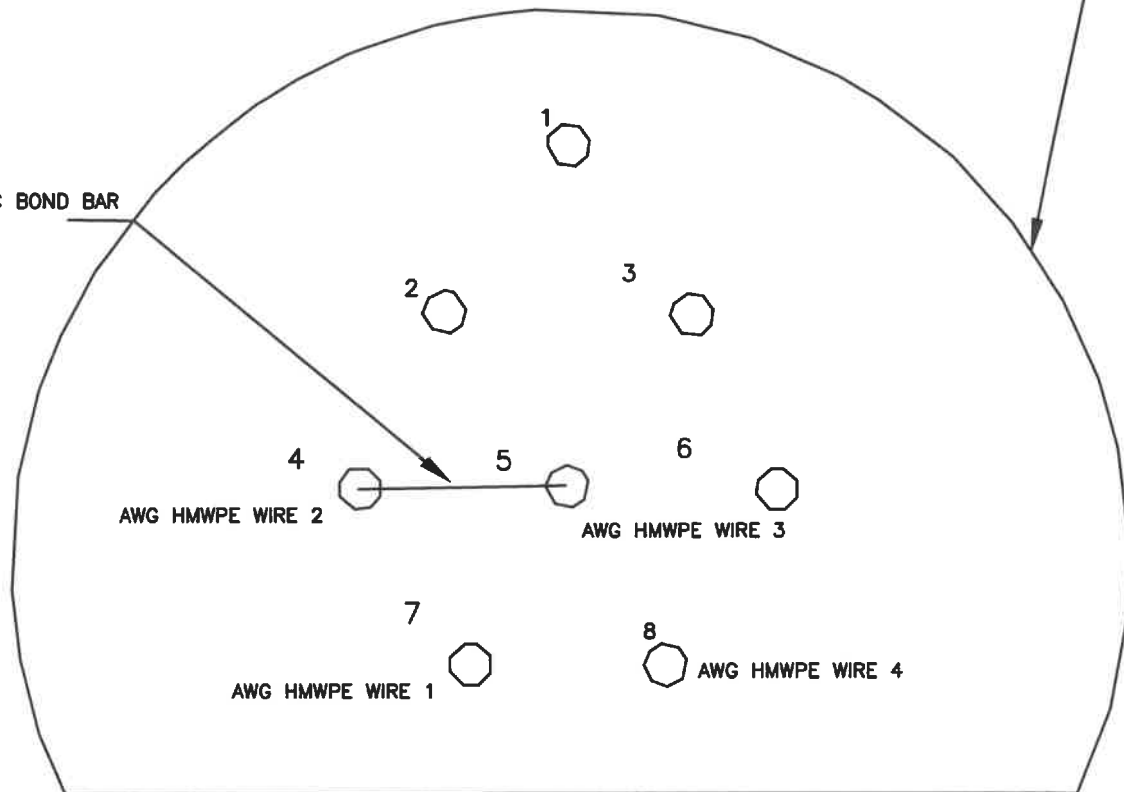

- TERMINAL #4 - AWG HMWPE WIRE 2 FROM WATER PIPE 1
 TERMINAL #5 - AWG HMWPE WIRE 3 FROM WATER PIPE 2
 TERMINAL #7 - AWG HMWPE WIRE 1 FROM WATER PIPE 1
 TERMINAL #8 - AWG HMWPE WIRE 4 FROM WATER PIPE 2

NOTES:

1. FOR BONDING OF CROSSING PIPELINES SEE SPECIAL DETAIL C/1.7, FOR PARALLEL PIPELINES SEE SPECIAL DETAIL C/1.7a.
2. IF MORE THAN TWO PIPELINES ARE BONDED, USE PIPELINE JUNCTION BOX, SEE SPECIAL DETAIL C/1.7b.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 7-26-21

Mike Harman

Chief Engineer

STANDARD DETAIL
FLUSH MOUNTED TEST
STATION TERMINAL BLOCK
FOR BONDED PIPELINES

C
4.0b