



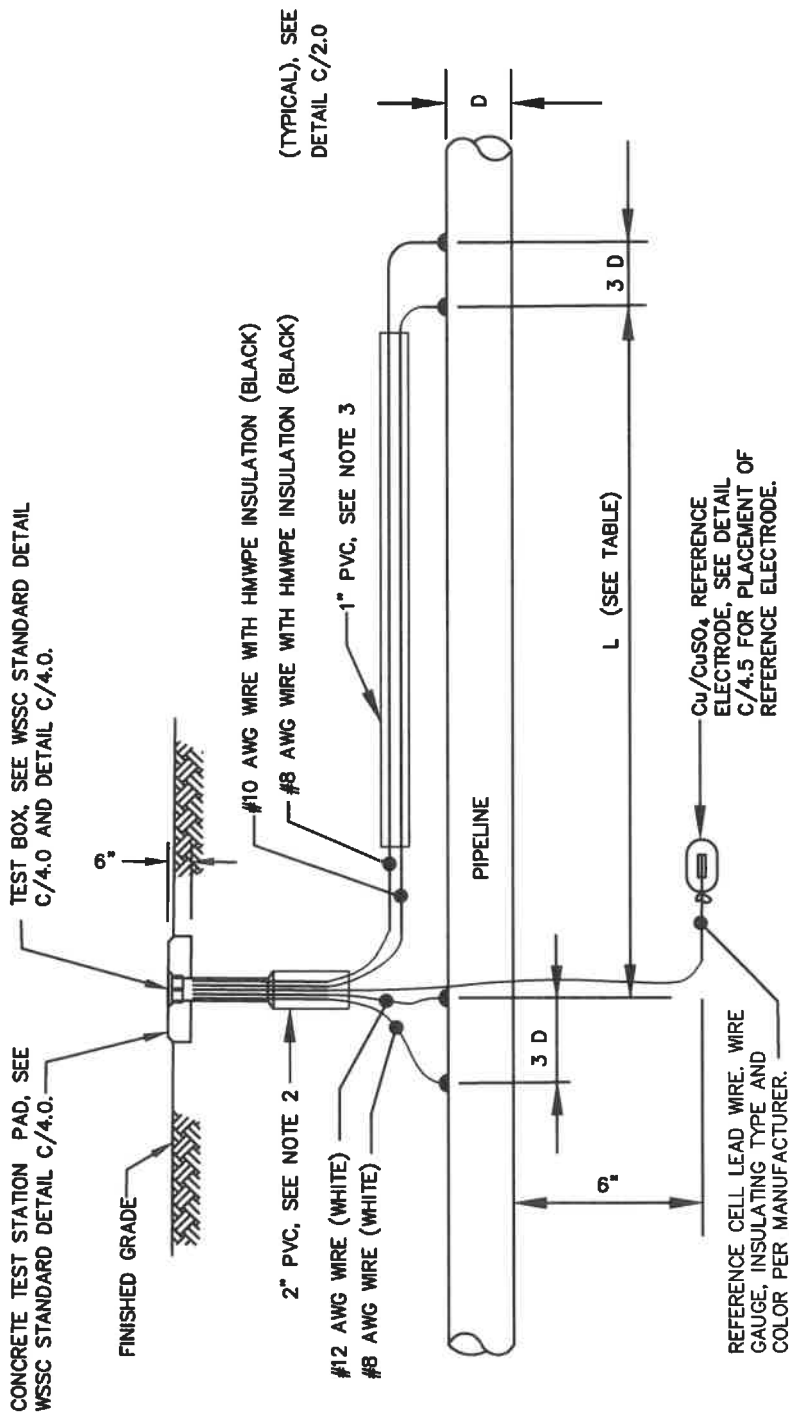

PIPE DIAMETER (D)	L (FEET)
4" TO 18"	100
20"	120
24"	160
30" TO 36"	200
42" TO 48"	240
54" TO 60"	300

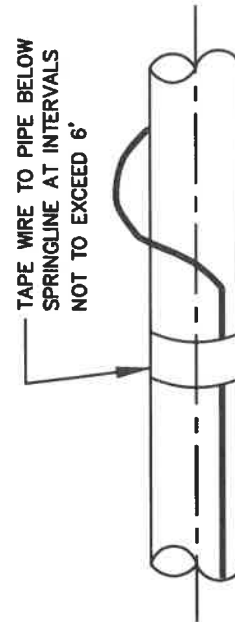

NOTE:

- EXCEPT AS SPECIFIED ABOVE, TEST LEAD WIRES SHALL MEET REQUIREMENTS OF DETAIL C/3.0.
- RUN ALL WIRES IN 2" PVC SCH40 CONDUIT FROM CONNECTION POINTS UNTIL THEY REACH THE BOTTOM OF TEST STATION ASSEMBLY.
- ROUTE BLACK #8 AND #10 LEAD WIRES IN 1" SCH 40 PVC CONDUIT. TERMINATE CONDUIT AT HORIZONTAL TO VERTICAL TRANSITION WHERE BLACK LEADS JOIN OTHER LEADS TO BE BROUGHT INTO TEST STATION ASSEMBLY.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 7-26-21
Mike Hammer
Chief Engineer

STANDARD DETAIL
IR DROP TEST
STATION FOR
DUCTILE IRON PIPE

C
4.6