


IN-LINE FLUSHING CONNECTION

(2 1/2" THROUGH 4")

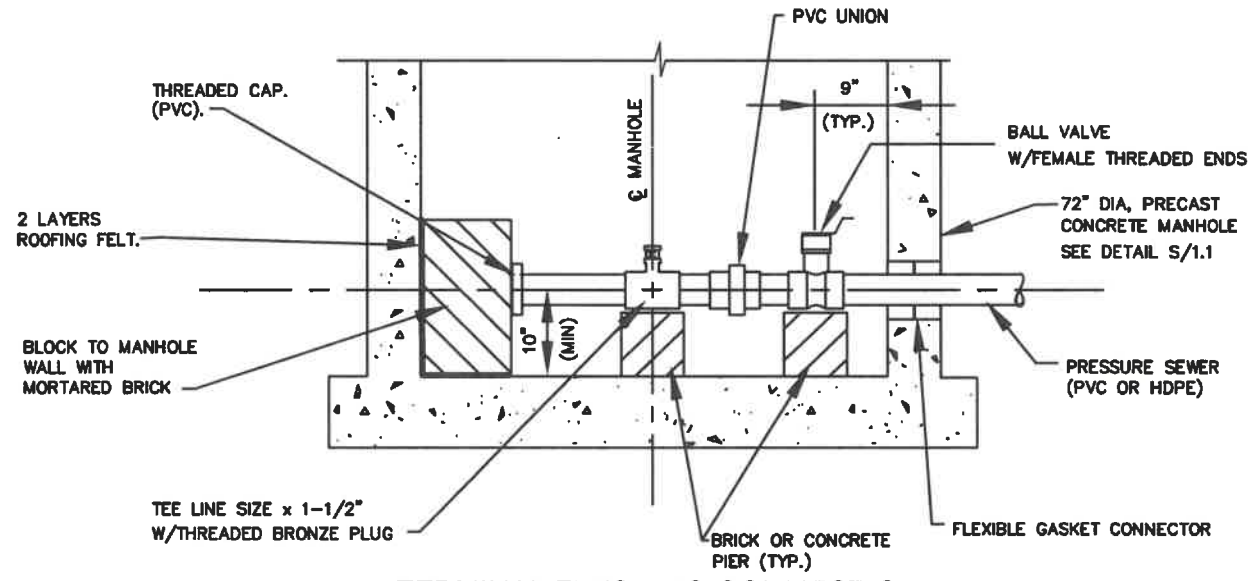

TERMINAL FLUSHING CONNECTION

(2 1/2" THROUGH 4")

NOTES:

1. ALL JOINTS SHOWN SHALL BE SOLVENT CEMENT UNLESS OTHERWISE NOTED.
2. FOR OTHER MANHOLE DETAILS, SEE DETAIL S/1.2.
3. ALLOW SUFFICIENT SPACE FOR UNSCREWING UNION.
4. FOR HDPE PIPE, PROVIDE TRANSITION FITTING AT CONNECTION TO BALL VALVE.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>7-26-21</u> Chief Engineer	STANDARD DETAIL FLUSHING CONNECTION 2-1/2" THROUGH 4"	PS 1.3
--	--	--	-----------