



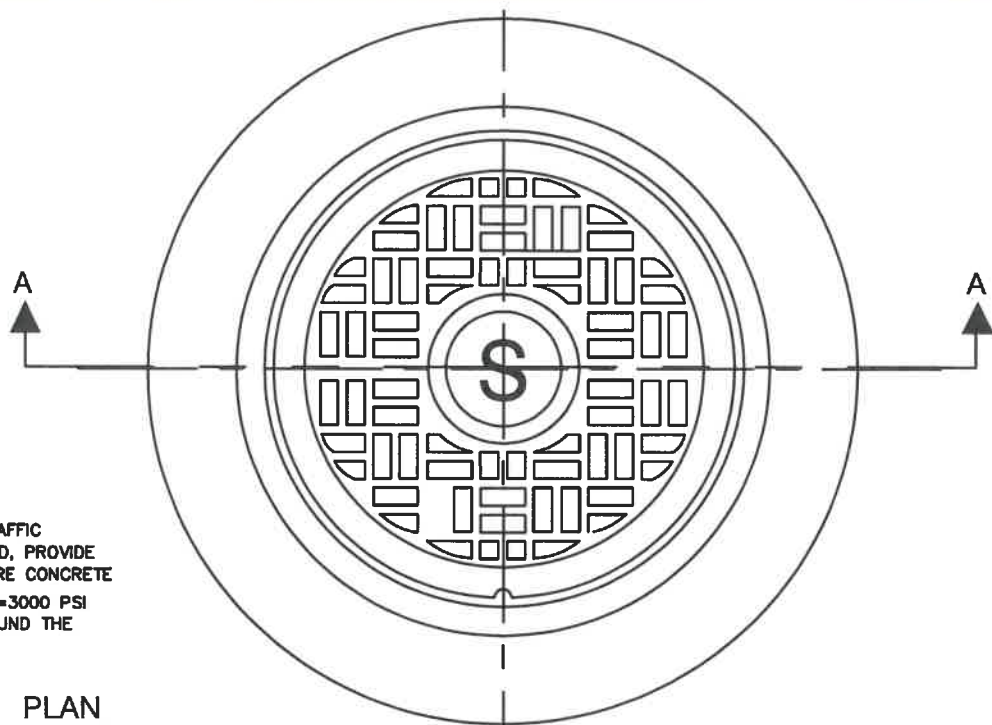

NOTE: IN VEHICULAR TRAFFIC
AREAS NOT PAVED, PROVIDE
2'x2'x8"(H) SQUARE CONCRETE
ENCASEMENT ($f'_c=3000$ PSI
● 28 DAYS) AROUND THE
FRAME.

PLAN

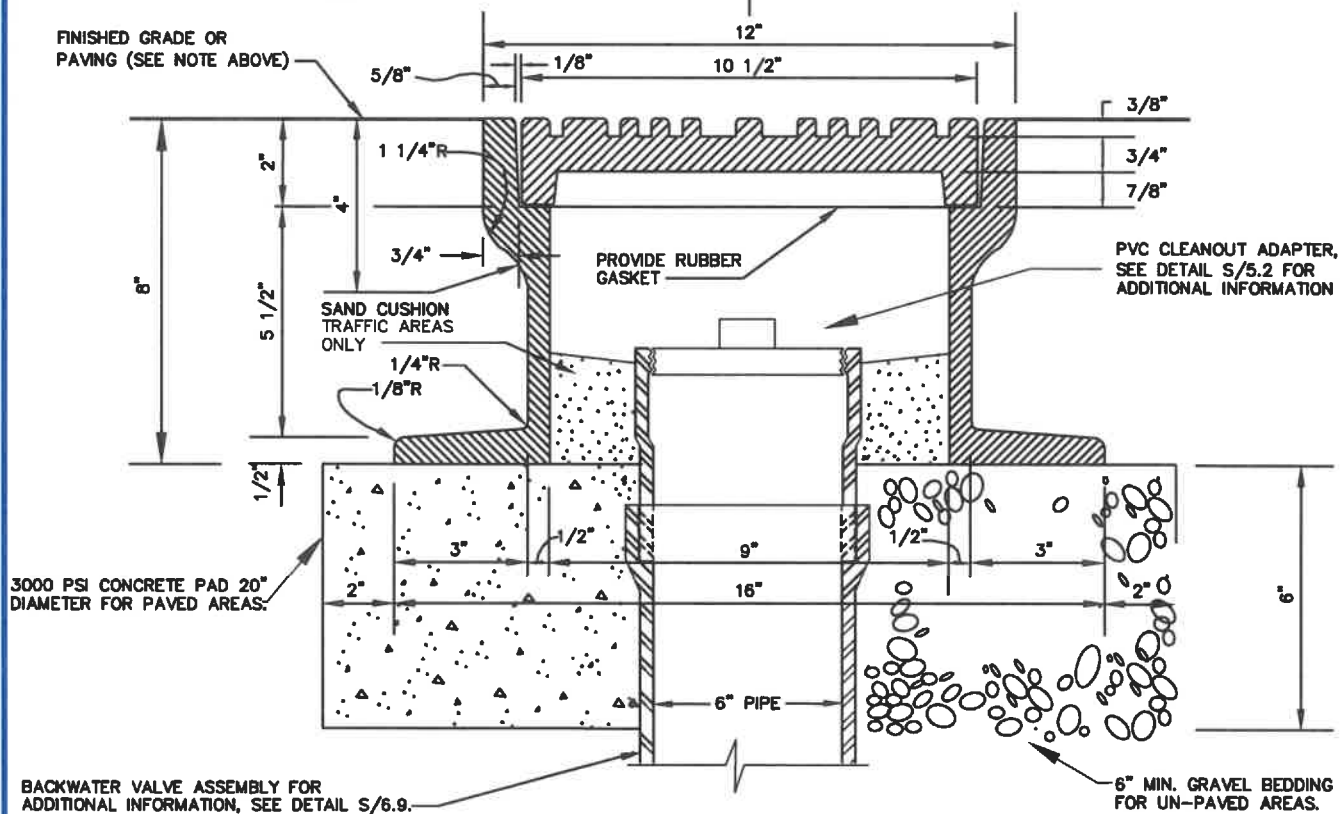

SECTION A-A

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 7-7-21
M. H. Hammer
Chief Engineer

STANDARD DETAIL
BACKWATER VALVE (LAMPHOLE)
COVER ASSEMBLY

S
6.9a