


CONNECT ANODE TO VALVE WITH BOLTED
CONNECTION, SEE DETAIL C/1.2

4", 6", 8", OR 10" PVC PIPE

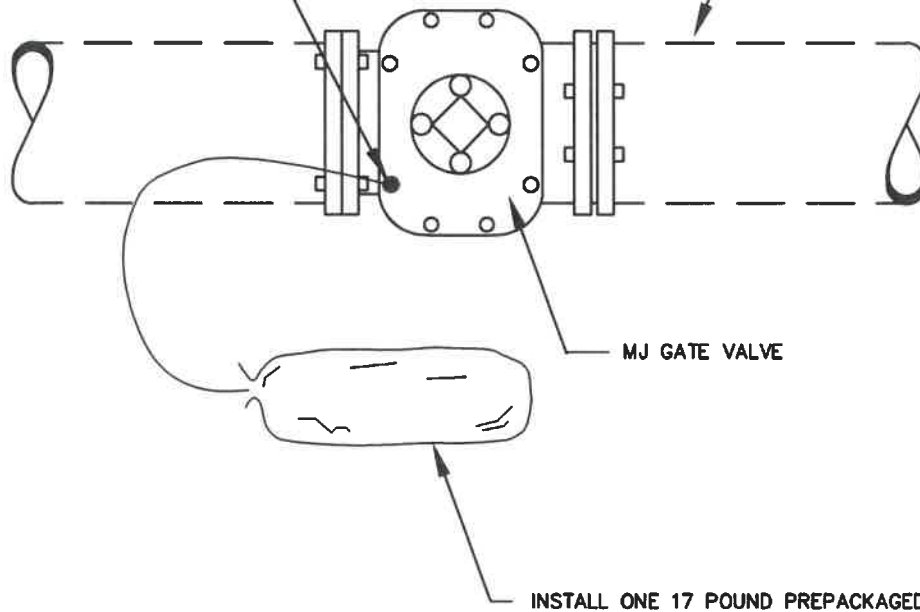

NOTES:

1. ANODE PLACED AT SAME DEPTH AS THE BOTTOM OF PIPE AND AT A MINIMUM OF 12" FROM EDGE OF PIPE, SEE DETAIL C/7.12.
2. DO NOT THERMITE WELD TO PVC PIPE.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 7-26-21
M. H. Hammer
Chief Engineer

STANDARD DETAIL

PVC AWWA C-900 PIPE
4-INCH, 6-INCH, 8-INCH, OR 10-INCH
ANODE PROTECTION VALVE

C
7.0