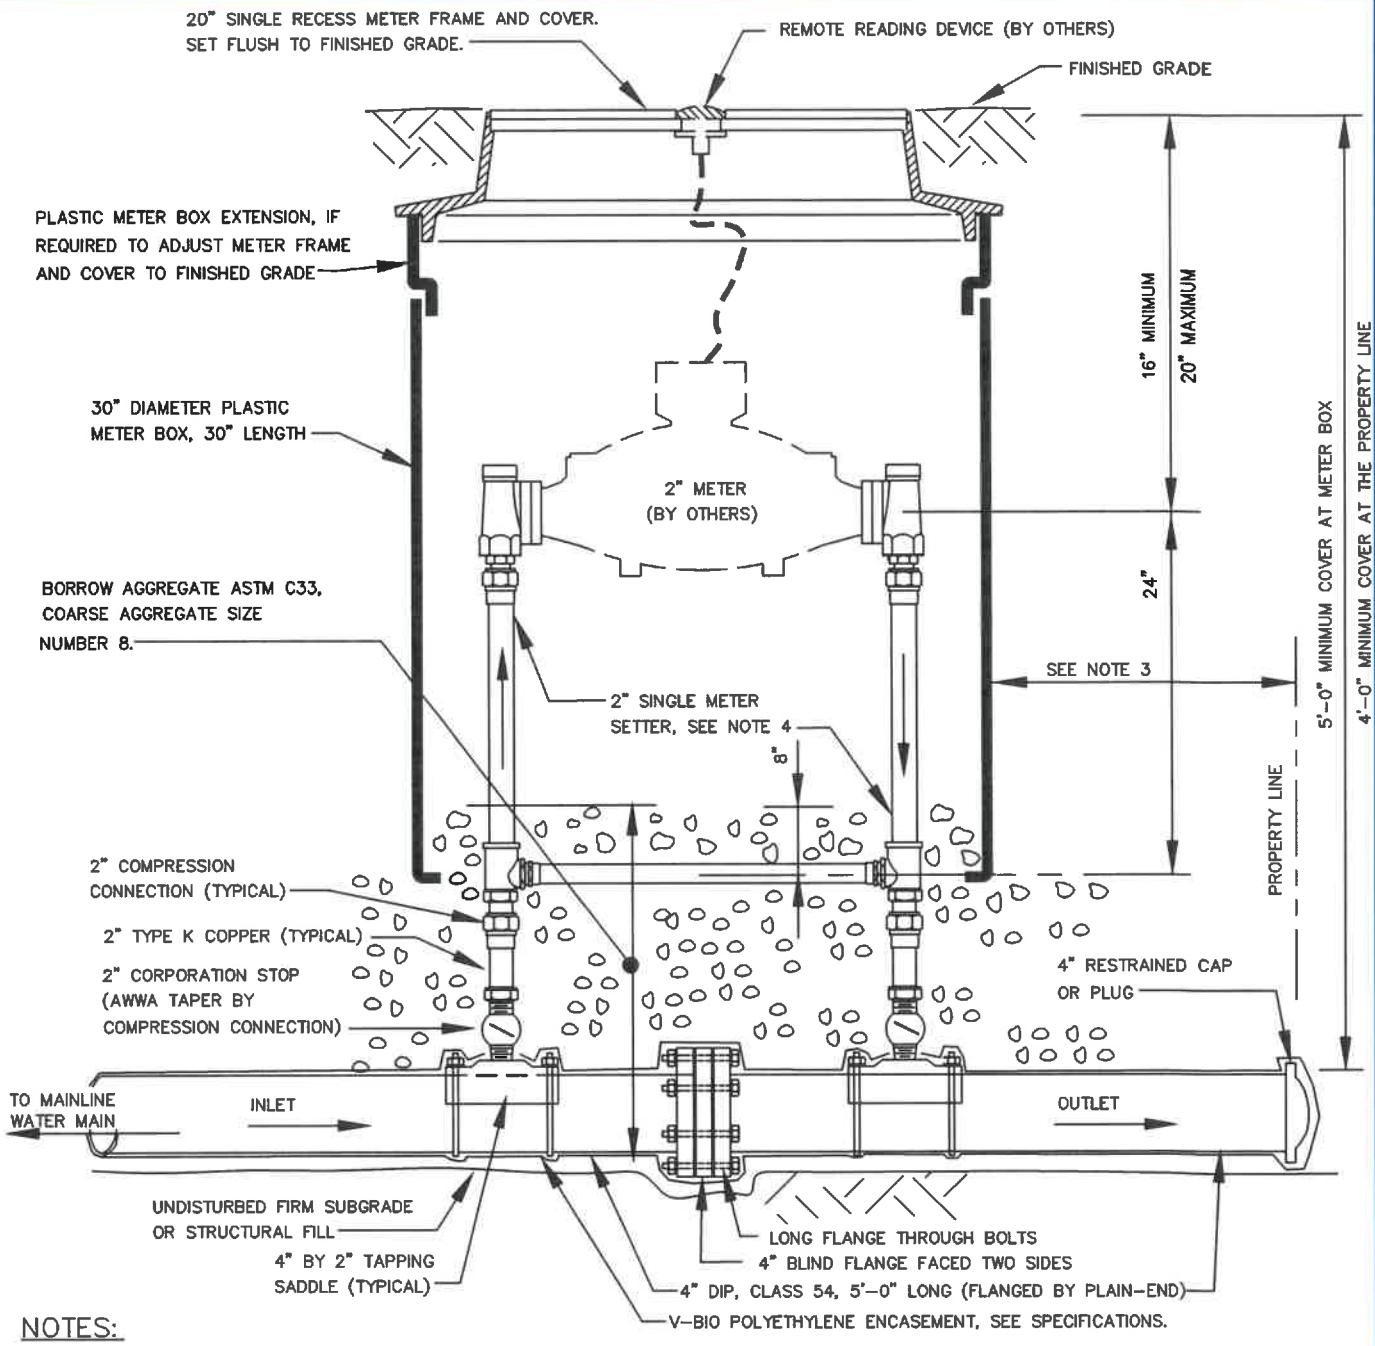

NOTES:

1. METER SETTING FOR NON-TRAFFIC AREAS ONLY, DO NOT LOCATE IN SIDEWALK OR DRIVEWAY, UNLESS OTHERWISE NOTED ON THE DRAWINGS.
2. COMPACT BACKFILL AND AGGREGATE BASE AS STRUCTURAL FILL.
3. EXTEND DUCTILE IRON SERVICE OUTLET 3'-0" MINIMUM BEYOND METER BOX OR PROPERTY LINE, WHICHEVER IS GREATER.
4. 2" SINGLE METER SETTER IS COMPLETE ONE-PIECE FACTORY ASSEMBLED, INCLUDING TWO ANGLE BALL VALVES, FITTINGS AND COMPRESSION CONNECTIONS.
5. RESTRAIN ALL PIPE JOINTS ON 4" DUCTILE IRON SERVICE, FROM THE MAINLINE WATER MAIN TO THE PLUG OR CAP.
6. V-BIO REQUIRED ON NEW COPPER PIPE, SEE SPECIFICATIONS.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: 7-26-21 Chief Engineer	STANDARD DETAIL 2-INCH METER SETTING FOR 4-INCH SERVICE	W 5.9