


NOTE:

1. FLANGE BOLTS SHALL BE READILY ACCESSIBLE.
2. ALL VALVES SHALL BE BALL TYPE.
3. METER TO BE SET HORIZONTALLY.
4. SLEEVE SHALL REST ON 24" OF UNDISTURBED EARTH AND EXTEND THRU THE FOUNDATION WALL.
5. FOR METER SETTING WHEN METER ROOM IS NOT ADJACENT TO EXTERIOR BUILDING WALLS, SEE DETAIL W/7.2a.
6. REMOTE READER CONDUIT - NO BENDS GREATER THAN 45°, PER FITTING UNLESS USING 90° SWEEP.
7. SECURE REMOTE READER CONDUIT TO WATER SERVICE LINE.
8. LOCATE EXIT POINT FOR REMOTE READING DEVICE 2'-1/2' TO 4' ABOVE FINISHED GRADE AND ON SAME WALL AS ELECTRIC METER. IF ELECTRIC METER IS LOCATED AT REAR OF BUILDING, LOCATE EXIT POINT IN FRONT OF BUILDING. REMOTE READER CABLE TO BE SUPPLIED BY WSSC.
9. THE WATER SERVICE LINE BETWEEN THE BALL VALVES SHALL BE COPPER.

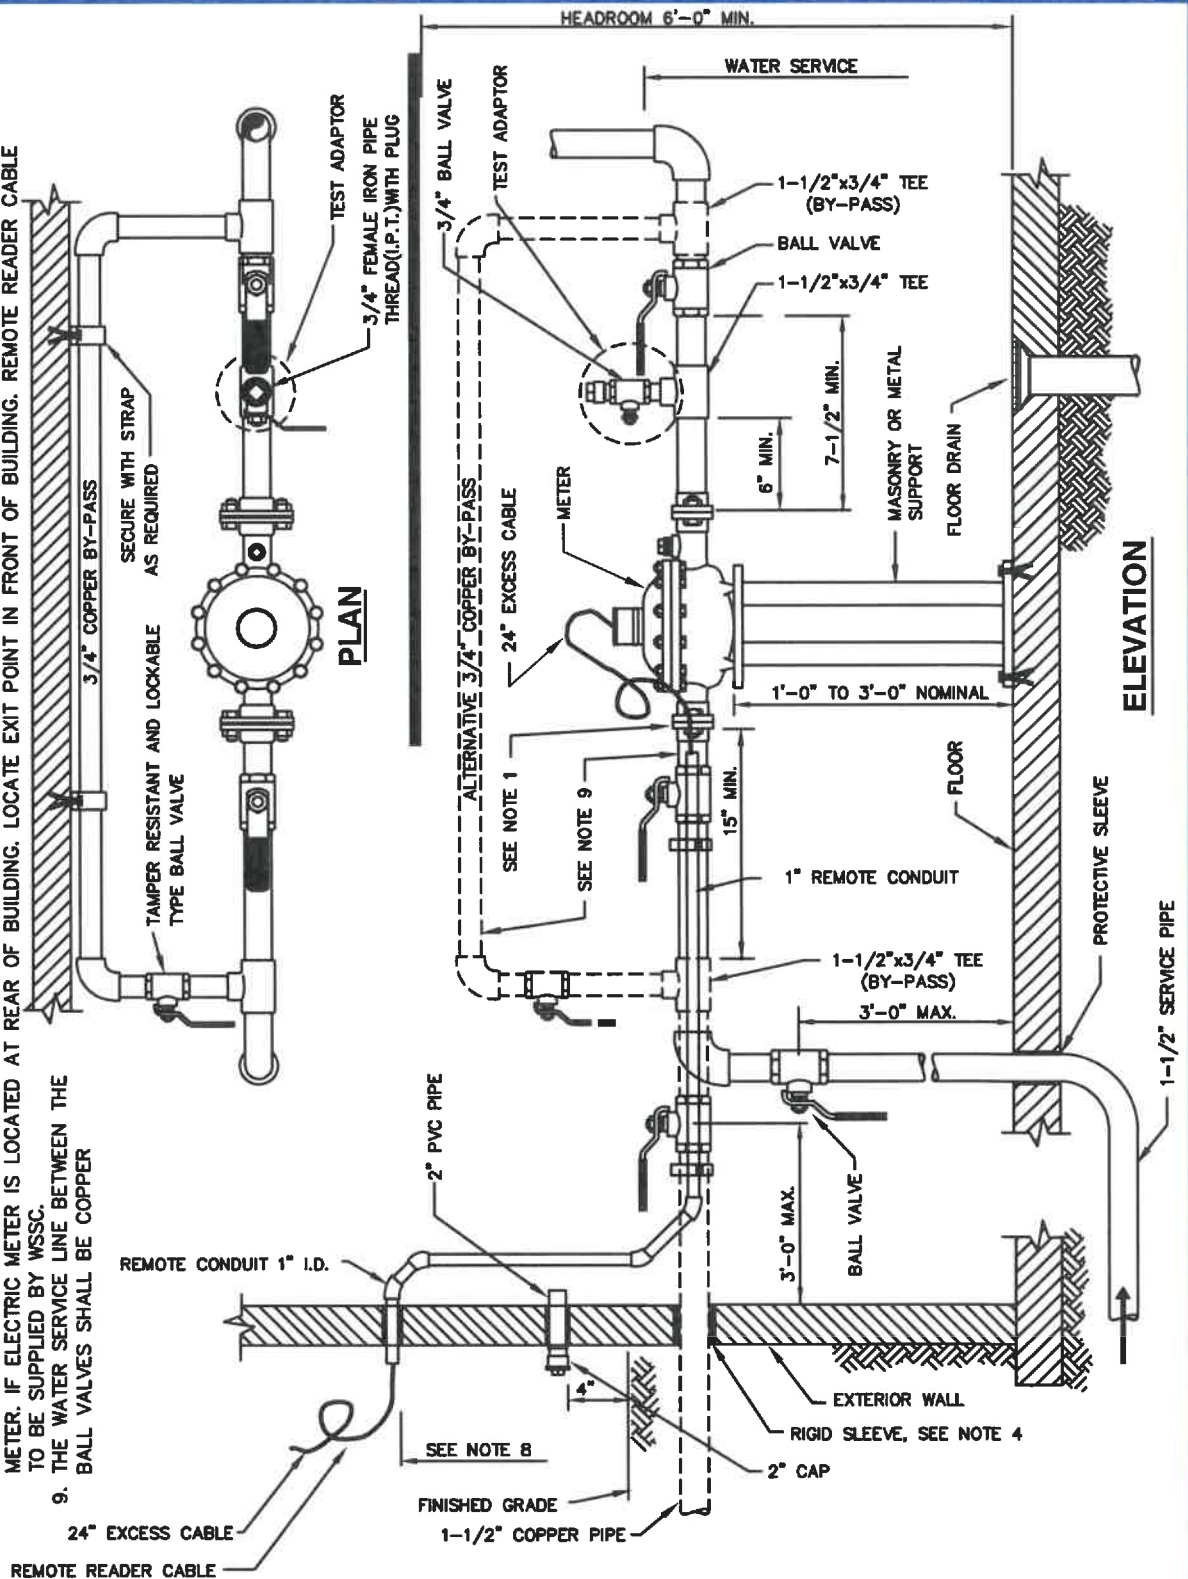

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 7-26-21
Mike Herman
Chief Engineer

STANDARD DETAIL
1-1/2-INCH INSIDE WATER METER
SETTING WHEN METER
ROOM IS ADJACENT TO
EXTERIOR BUILDING WALLS

W
7.2b