


PLAN - 36" AND LARGER MAINS

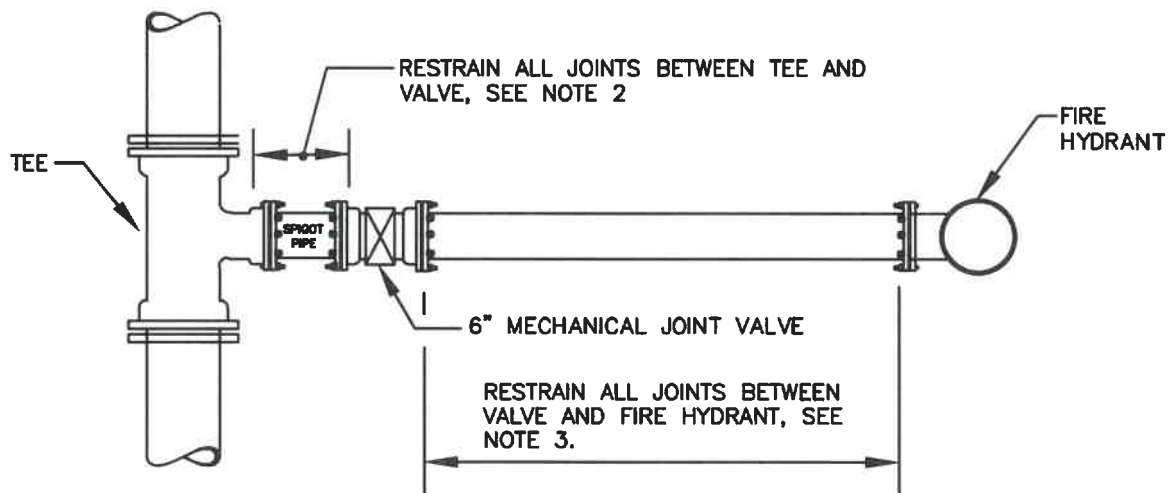

PLAN - 14" TO 30" MAINS

NOTES:

1. DO NOT BLOCK FIRE HYDRANT TEE OR FIRE HYDRANT.
2. RESTRAIN ALL JOINTS BETWEEN FIRE HYDRANT TEE AND VALVE, SEE DETAIL B/2.0
3. RESTRAIN ALL JOINTS FROM VALVE TO FIRE HYDRANT, USING WEDGE ACTION RESTRAINING GLANDS OR RESTRAINED JOINT GASKETS, SEE SPECIFICATIONS.
4. FOR WATER MAINS 36-INCH AND LARGER, USE TWO 6-INCH VALVES.
5. PLACE RESTRAINED JOINT PIPE TAPE ON TOP OF PIPE FROM FIRE HYDRANT TEE TO FIRE HYDRANT, SEE SPECIFICATIONS.

WASHINGTON  
SUBURBAN  
SANITARY  
COMMISSION

APPROVED: 7-26-21  
*Mike Harmon*  
Chief Engineer

STANDARD DETAIL  
METHOD OF RESTRAINING  
FIRE HYDRANT TO MAIN  
14-INCH AND LARGER

B  
2.2