


TYPE OF HYDRANT	H (IN.)	
	MIN.	MAX.
KENNEDY VALVE	17 1/4	23 1/4
MUELLER COMPANY	18	24
U.S. PIPE VALVE & HYDRANT DIV.	18	24
CLOW VALVE CO.	19 3/8	25 3/8
AMERICAN FLOW CONTROL	14	20

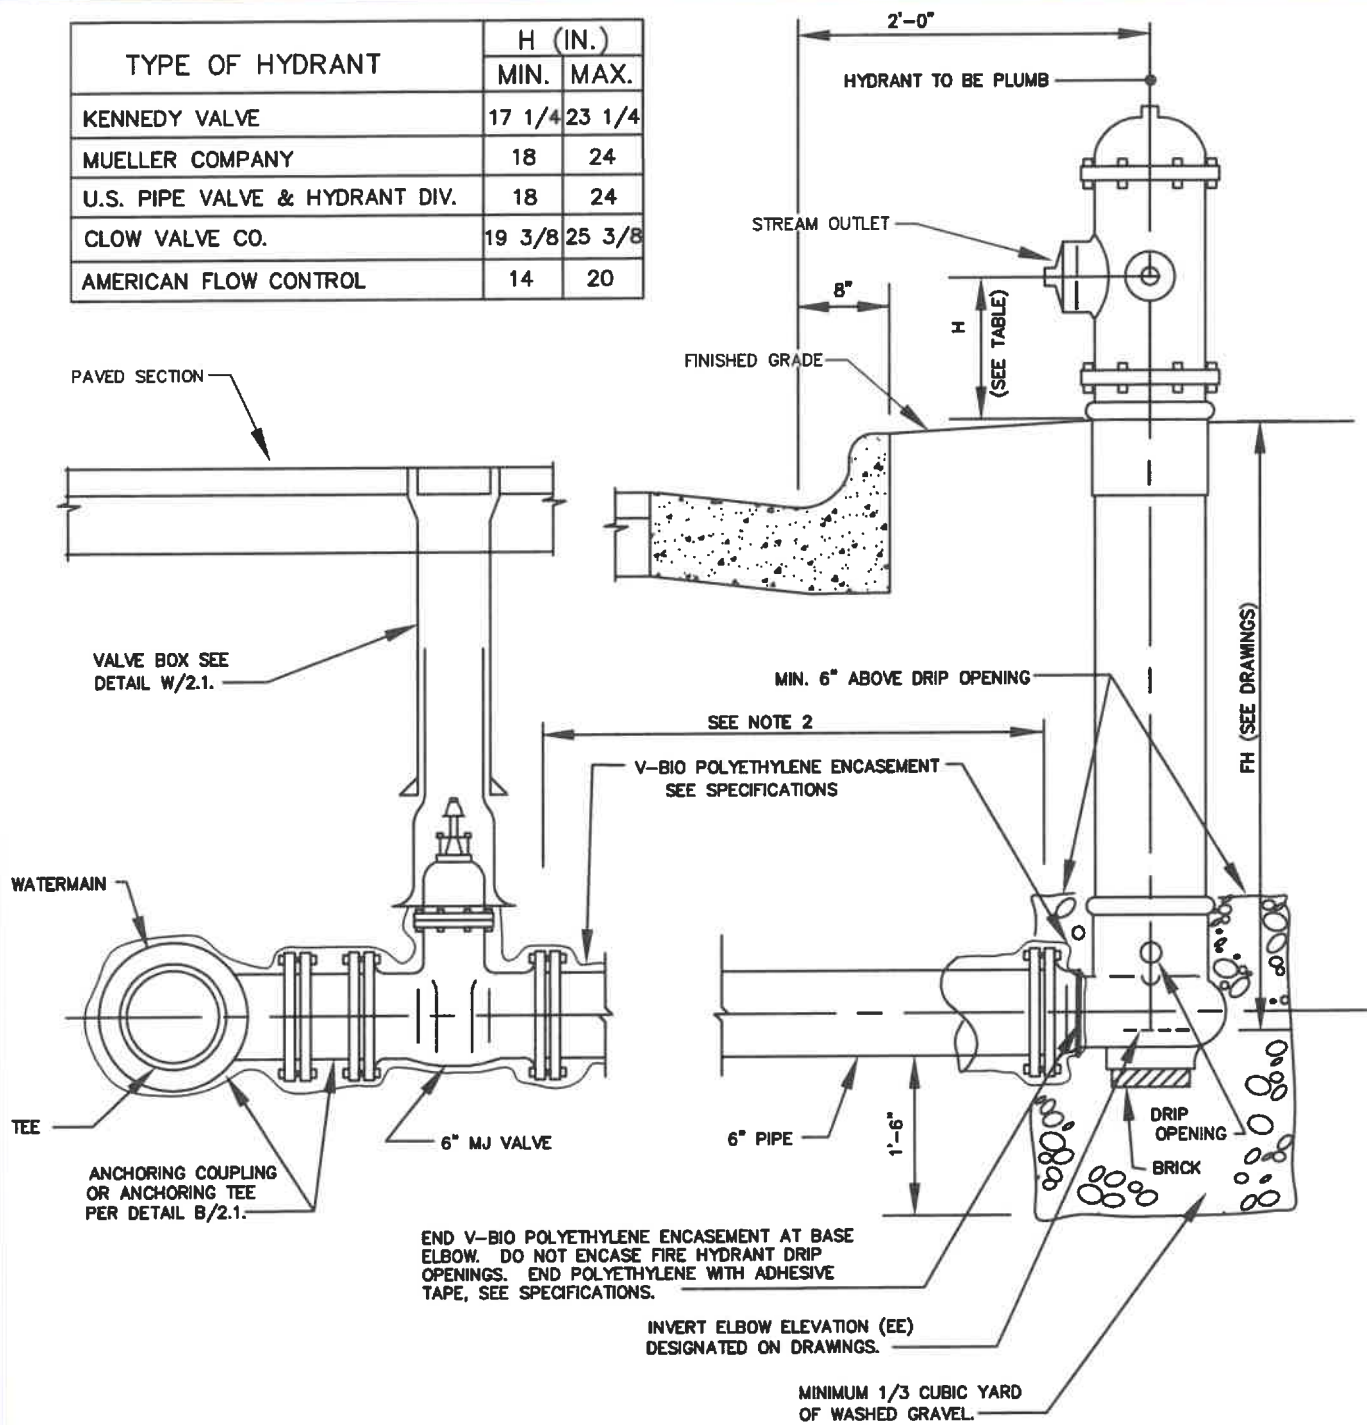

NOTES:

- DO NOT BLOCK FIRE HYDRANT OR FIRE HYDRANT TEE.
- FOR RESTRAINING VALVE TO FIRE HYDRANT, SEE DETAIL B/2.1.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 10/26/21
M. H. Harmon
Chief Engineer

STANDARD DETAIL
FIRE HYDRANT SETTING
CLOSED PAVING SECTION

W
8.0